




FEED POINT - TRAFFIC SIGNALS

D-772-1

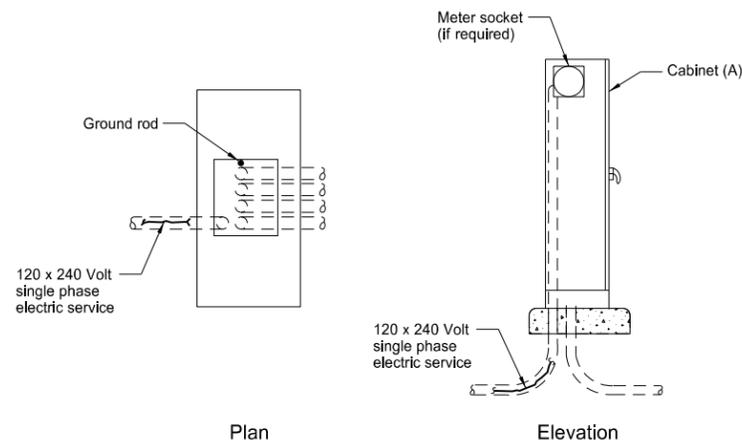


Circuit Breaker Cabinet Pad Mounted


(A) Cabinet shall be 56 in. high x 26 in. wide x 14 in. deep, 12 gauge steel (min.) or aluminum with provisions for padlock. Cabinet shall be weatherproof. A steel cabinet shall have one coat of primer and two coats of exterior dark green enamel.

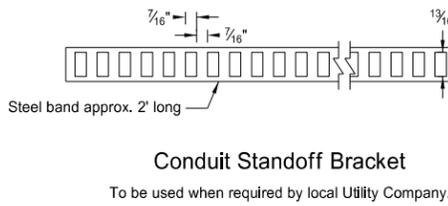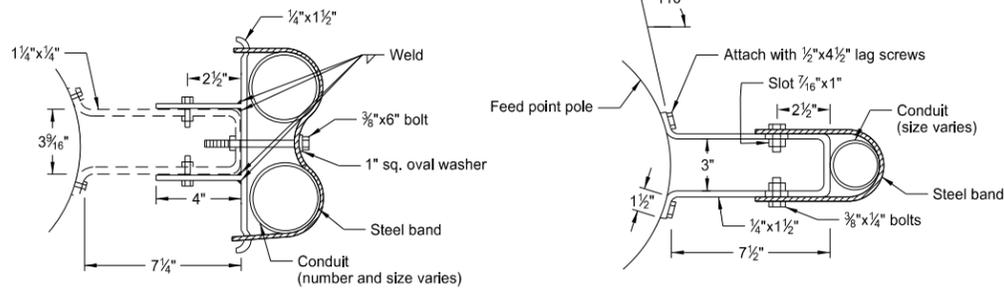


Conduit Standoff Bracket
To be used when required by local Utility Company.

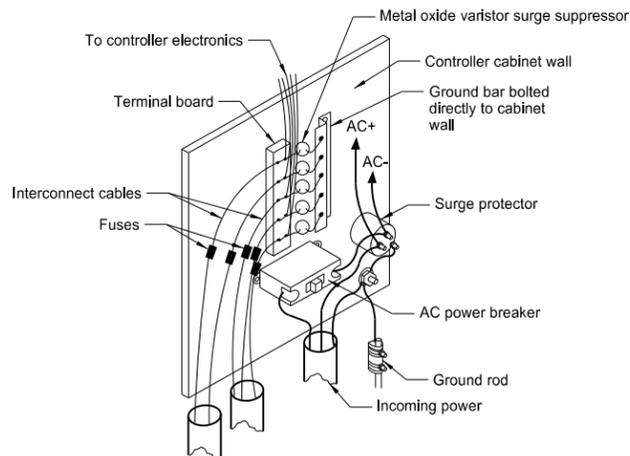

Controller Cabinet Interconnect and Power Cable Lightning Protection

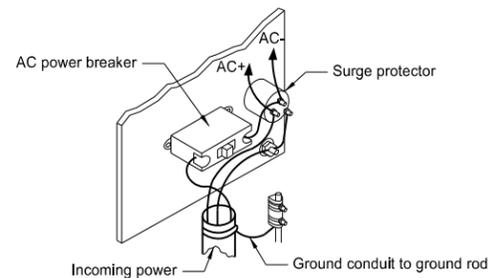

Feed Point Cabinet Lightning Protection

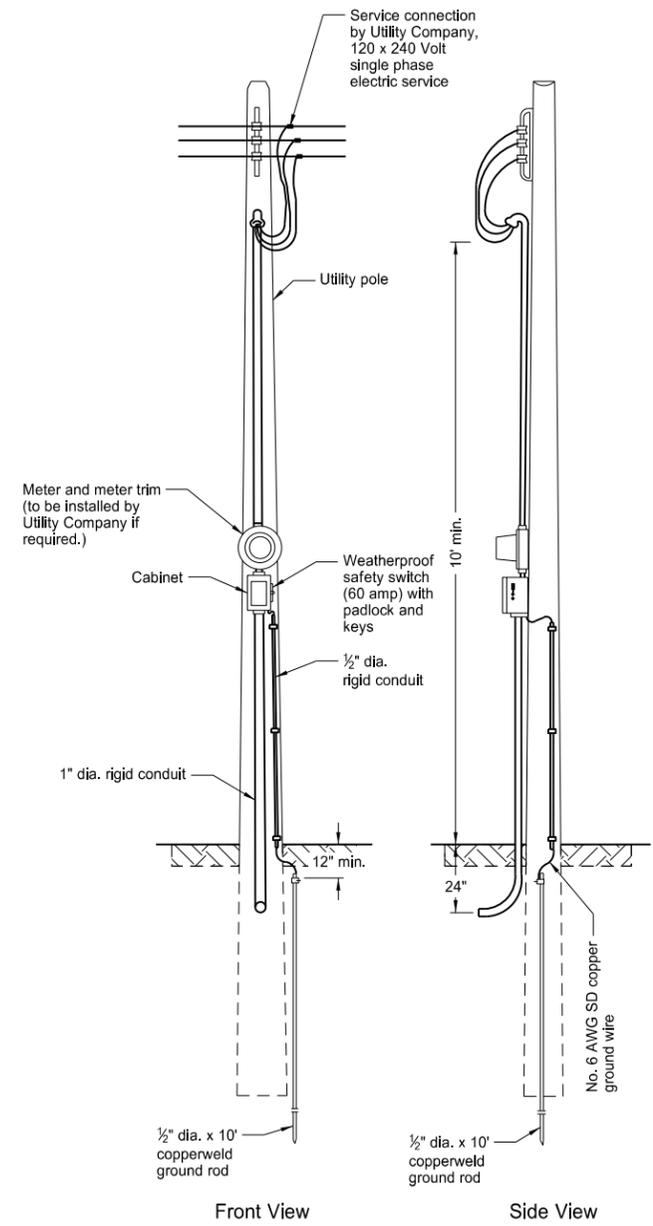

Front View

Side View

NORTH DAKOTA DEPARTMENT OF TRANSPORTATION	
11-14-13	
REVISIONS	
DATE	CHANGE

This document was originally issued and sealed by Roger Weigel, Registration Number PE-2930, on 11/14/13 and the original document is stored at the North Dakota Department of Transportation