



# COMBINATION FEED POINT DETAILS


D-770-2A

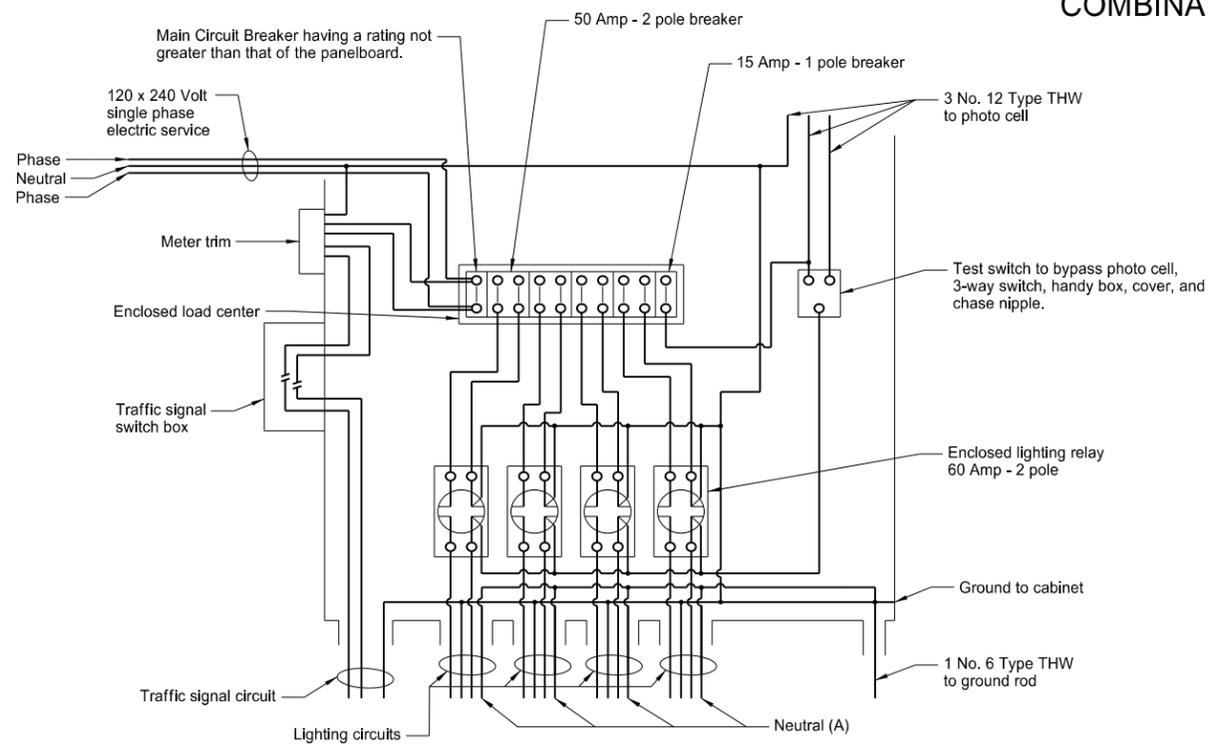

Combination Lighting and Signal Feed Point Type IV

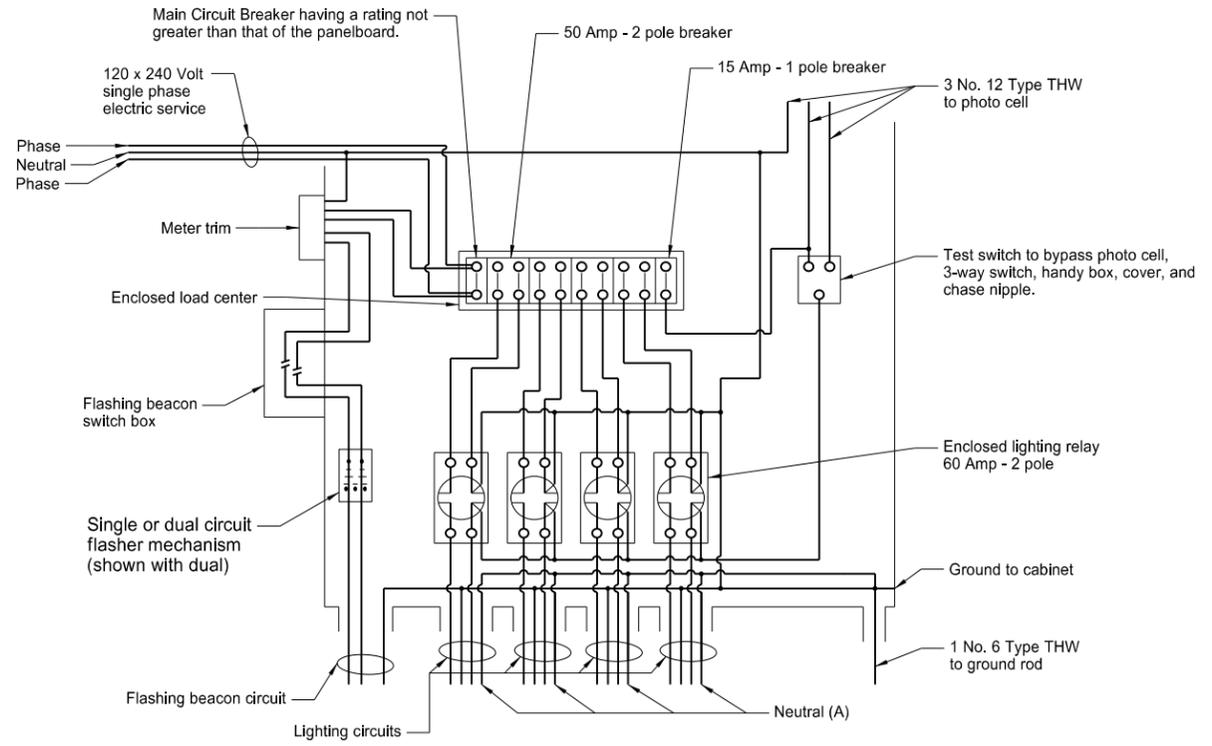

Combination Lighting and Flashing Beacon Feed Point Type IV

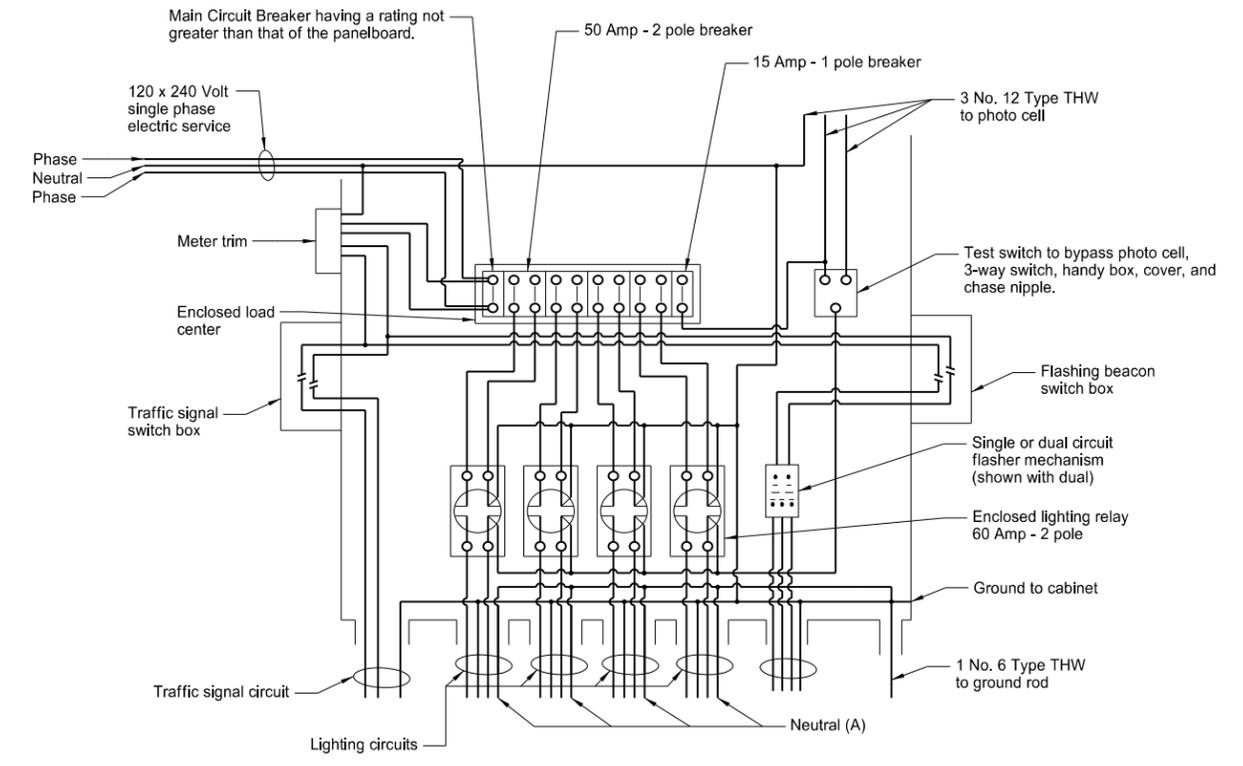

Combination Lighting, Signal, and Flashing Beacon Feed Point Type IV

Notes:  
 Install Type I feed point similar to Type IV, except with one electrical circuit, one 50 Amp - 2 pole breaker, and one lighting relay, normally open.  
 Install Type II feed point similar to Type IV, except with two electrical circuits, two 50 Amp - 2 pole breakers, and two lighting relays, normally open.  
 Install Type III feed point similar to Type IV, except with three electrical circuits, three 50 Amp - 2 pole breakers, and three lighting relays, normally open.  
 (A) Install when festoon circuits are required

NORTH DAKOTA DEPARTMENT OF TRANSPORTATION	
10-8-13	
REVISIONS	
DATE	CHANGE
10-17-17 8-28-19	Updated to active voice. New Design Engineer PE Stamp.

This document was originally issued and sealed by  
 Kirk J Hoff,  
 Registration Number  
 PE- 4683,  
 on 8/28/19 and the original document is stored at the  
 North Dakota Department  
 of Transportation