



MANHOLE DETAILS

D-722-5

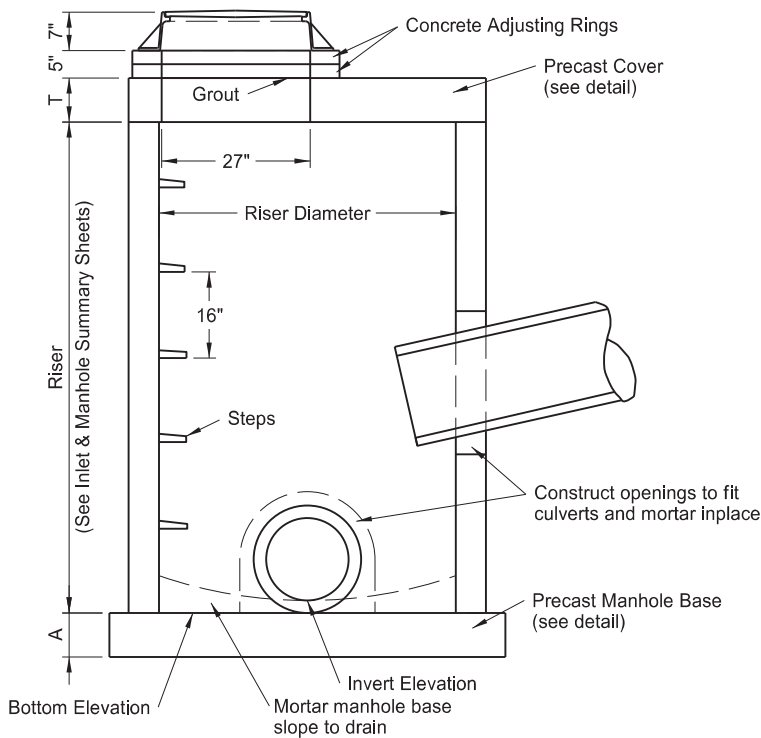

ELEVATION

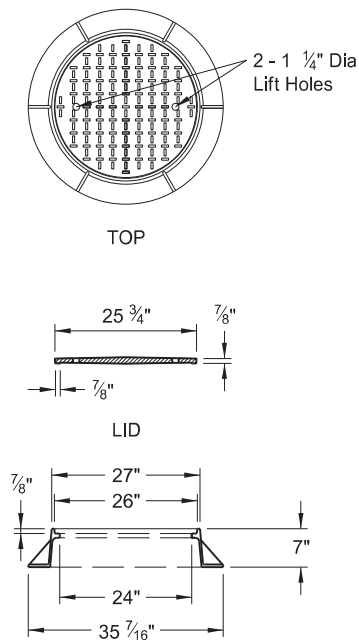

FRAME

MANHOLE CAST IRON RING & COVER

PRECAST MANHOLE COVERS

RISER DIAMETER	COVER DIAMETER	WEIGHT OF SECTION	T	K	L	BOTTOM * BARS	TOP * BARS
48"	58"	1,080 Lb	6"	6"	8"	#4 at 6"	---
54"	65"	1,910 Lb	8"	6"	8"	#4 at 6"	---
60"	72"	2,430 Lb	8"	7"	9"	#4 at 6"	#4 at 11"
66"	79"	3,010 Lb	8"	7"	9"	#4 at 6"	#4 at 11"
72"	86"	3,640 Lb	8"	8"	10"	#4 at 6"	#4 at 11"
84"	100"	5,060 Lb	8"	9"	11"	#5 at 6"	#5 at 11"
96"	114"	6,695 Lb	8"	9"	11"	#5 at 6"	#5 at 11"
108"	128"	12,810 Lb	12"	10"	12"	#5 at 6"	#5 at 11"
120"	142"	15,900 Lb	12"	11"	13"	#5 at 6"	#5 at 11"

\* - Place reinforcement listed in each direction.


MANHOLE BASES

RISER DIAMETER	BASE DIAMETER	WEIGHT OF SECTION	A	BARS *
48"	66"	1,785 Lb	6"	#4 at 12"
54"	72"	2,830 Lb	8"	#4 at 12"
60"	78"	3,320 Lb	8"	#4 at 12"
66"	86"	4,035 Lb	8"	#4 at 12"
72"	92"	4,620 Lb	8"	#4 at 12"
84"	107"	6,245 Lb	8"	#4 at 12"
96"	120"	7,855 Lb	8"	#4 at 12"
108"	132"	14,255 Lb	12"	#4 at 8"
120"	148"	17,925 Lb	12"	#4 at 8"


\* - Place reinforcement listed in each direction.

NOTES:


1. Use class AE concrete precast or cast-in-place bases constructed in accordance with NDDOT Standard Specifications. Use aggregate size approved by the engineer.
2. Use precast concrete manholes, risers and steps conforming to AASHTO M199.
3. Reinforce precast concrete bases and covers as shown in the table for the corresponding riser diameter.
4. Use Grade 60 reinforcing steel.
5. Cut or Precast manhole riser bottoms square to fit the manhole base. Grout joint between base and riser with cement mortar.
6. The manhole riser length listed in the plans is based on a 7" manhole casting, plus 2 concrete adjusting rings (5"), plus the "T" dimension shown in the Precast Manhole Covers table.
7. Use corrosion resistant manhole steps with a minimum 800 pound vertical load resistance and a minimum 400 pound horizontal pull-out resistance. Use configuration of steps approved by the Engineer.
8. Precast concrete manhole covers shown are designed for an HS-20 wheel load and maximum fill height of 15'-0". Special design is required for heavier wheel loads and/or greater fill heights.
9. Use of other castings, similar in dimension, is allowed if the casting conforms to the manhole cover and has a lid style specified in the plans. Modifications to the manhole cover to facilitate similar castings are only allowed with written approval from the Engineer.
10. Use castings manufactured in accordance with AASHTO M306-09. Use metal conforming to AASHTO M105 Class 35B in the manufacture of castings.
11. Pipe shall be installed to extend a minimum of 2 inches beyond the inside face of the structure wall at each end. Payment will be based on the actual installed length of pipe between structures, measured end-to-end and rounded to the nearest whole foot.

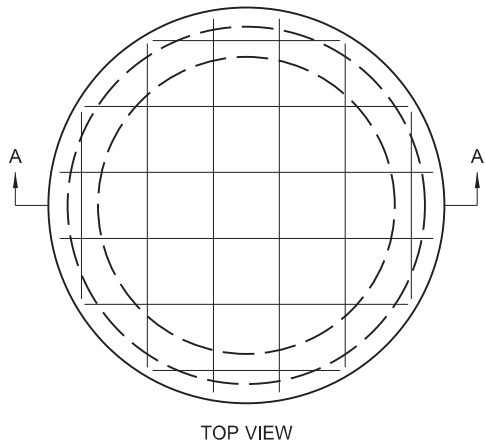


TOP VIEW

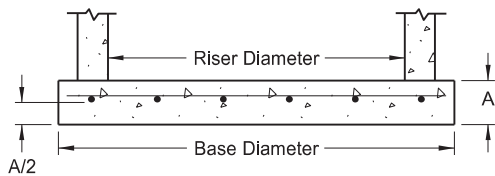


SECTION A-A  
PRECAST MANHOLE BASE

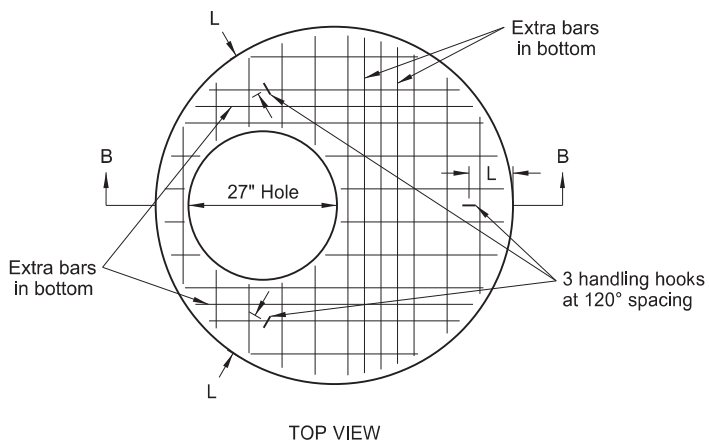


TOP VIEW

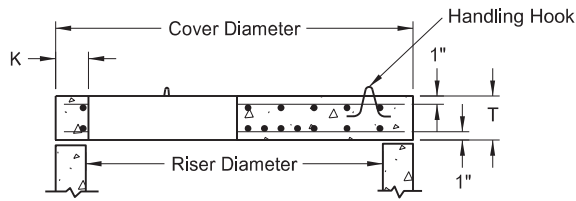

SECTION B-B  
PRECAST COVER

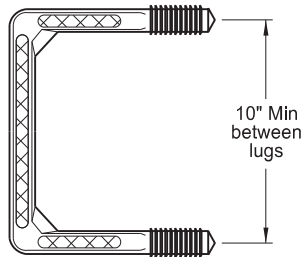

TOP VIEW

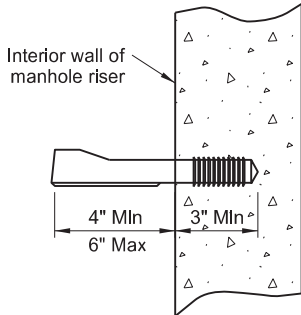

STEP DETAIL

NORTH DAKOTA DEPARTMENT OF TRANSPORTATION	
05-14-2013	
REVISIONS	
DATE	CHANGE
6-24-14	Revised notes 1 & 6, added dimensions to Elev. drawing.
10-17-17	Updated to active voice.
12-02-20	Updated PE stamp and signature.
07-24-25	Note Revisions

